ACCEPTED FOR PROCESSING - 2020 March 3 10:46 AM - SCPSC - 2020-43-E - Page 1 of 1

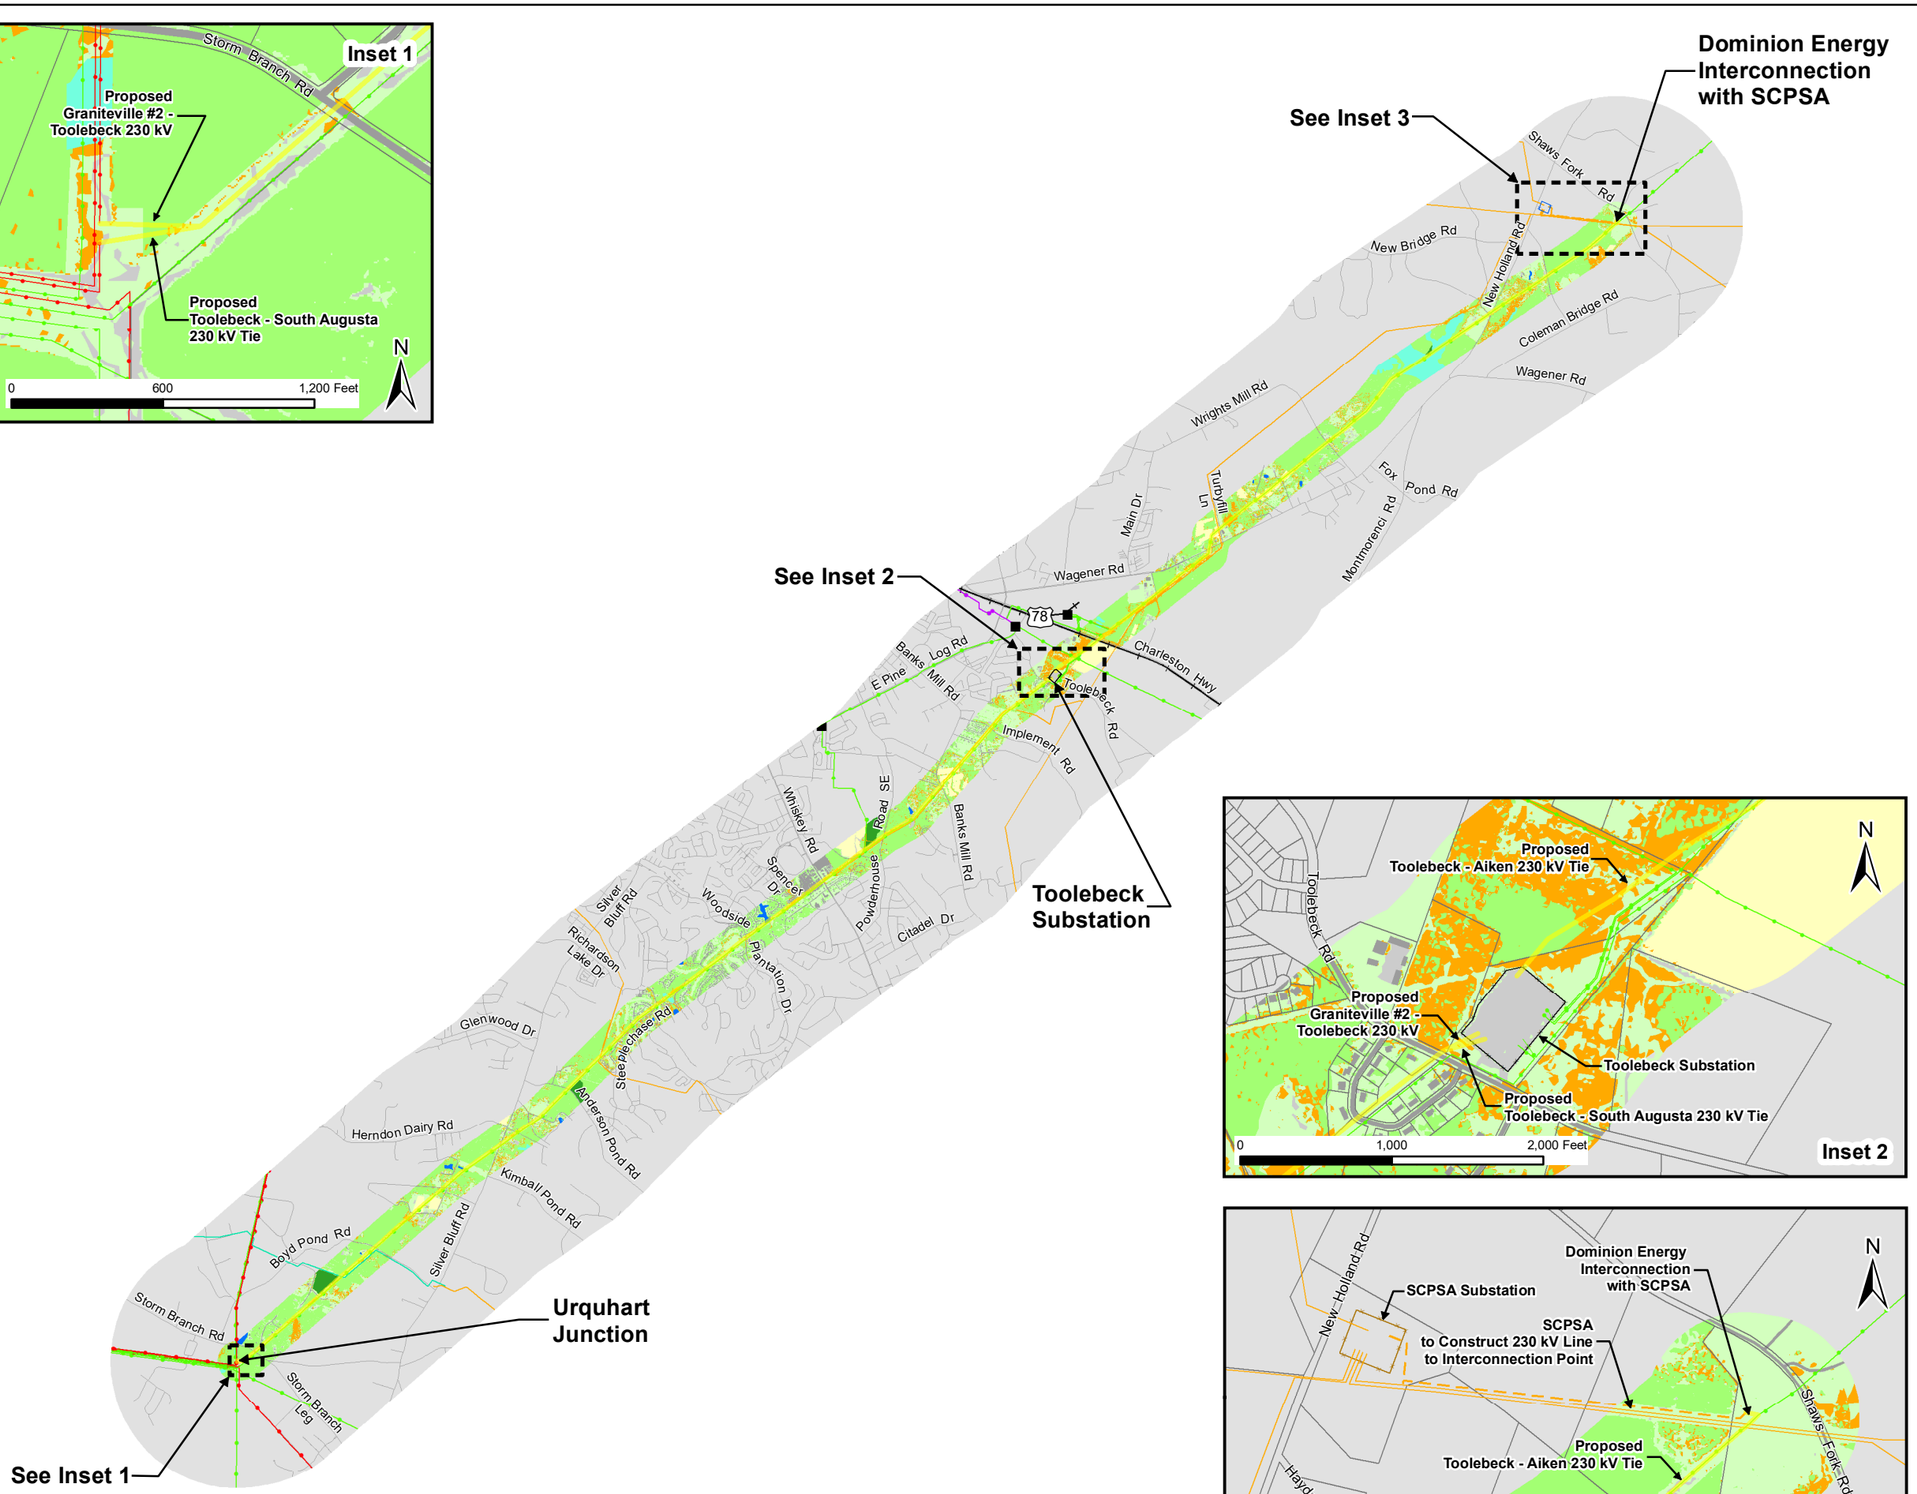

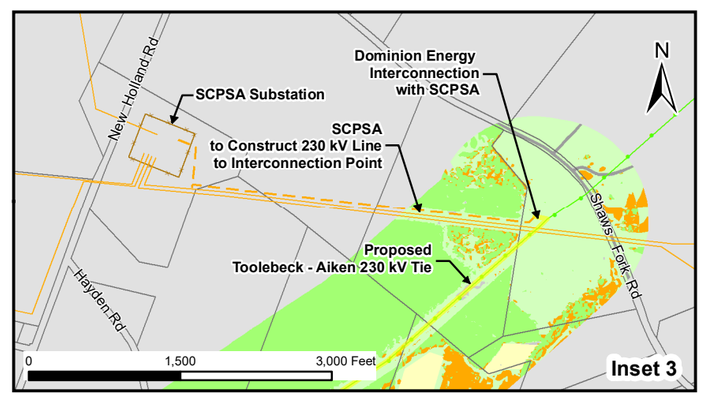

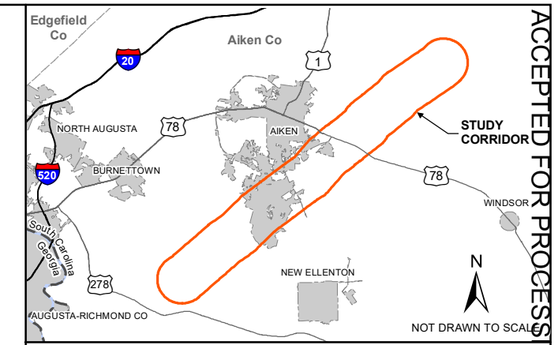

Legend

- Dominion Energy Substation
- Road
- Railroad
- Proposed Dominion Energy 230 kV Transmission Line
- Dominion Energy 46 kV Transmission Line
- Dominion Energy 115 kV Transmission Line
- Dominion Energy 230 kV Transmission Line
- SCPSA Transmission Line
- Central Electric Transmission Line
- Property Line
- Study Corridor
- Agriculture
- Barren
- Grass/Pasture
- Mixed Hardwood/Pine Forest
- Pine Plantation
- Scrub/Shrub
- Urban/Built-up
- Water
- Wetland

N W E S

0 1.5 3 Miles

Source: USDA 2017 Aerial Photography, Field Reconnaissance, and Palmetto Environmental Consulting, Inc.

Land Cover

Toolebeck - Aiken 230 kV Tie, Graniteville #2 - Toolebeck 230 kV, Toolebeck - South Augusta 230 kV Tie, and Associated Facilities

Aiken County, SC

Dominion Energy®

FIGURE 5.6