ACCEPTED FOR PROCESSING - 2020 March 3 10:47 AM - SCPSC - 2020-43-E - Page 1 of 1

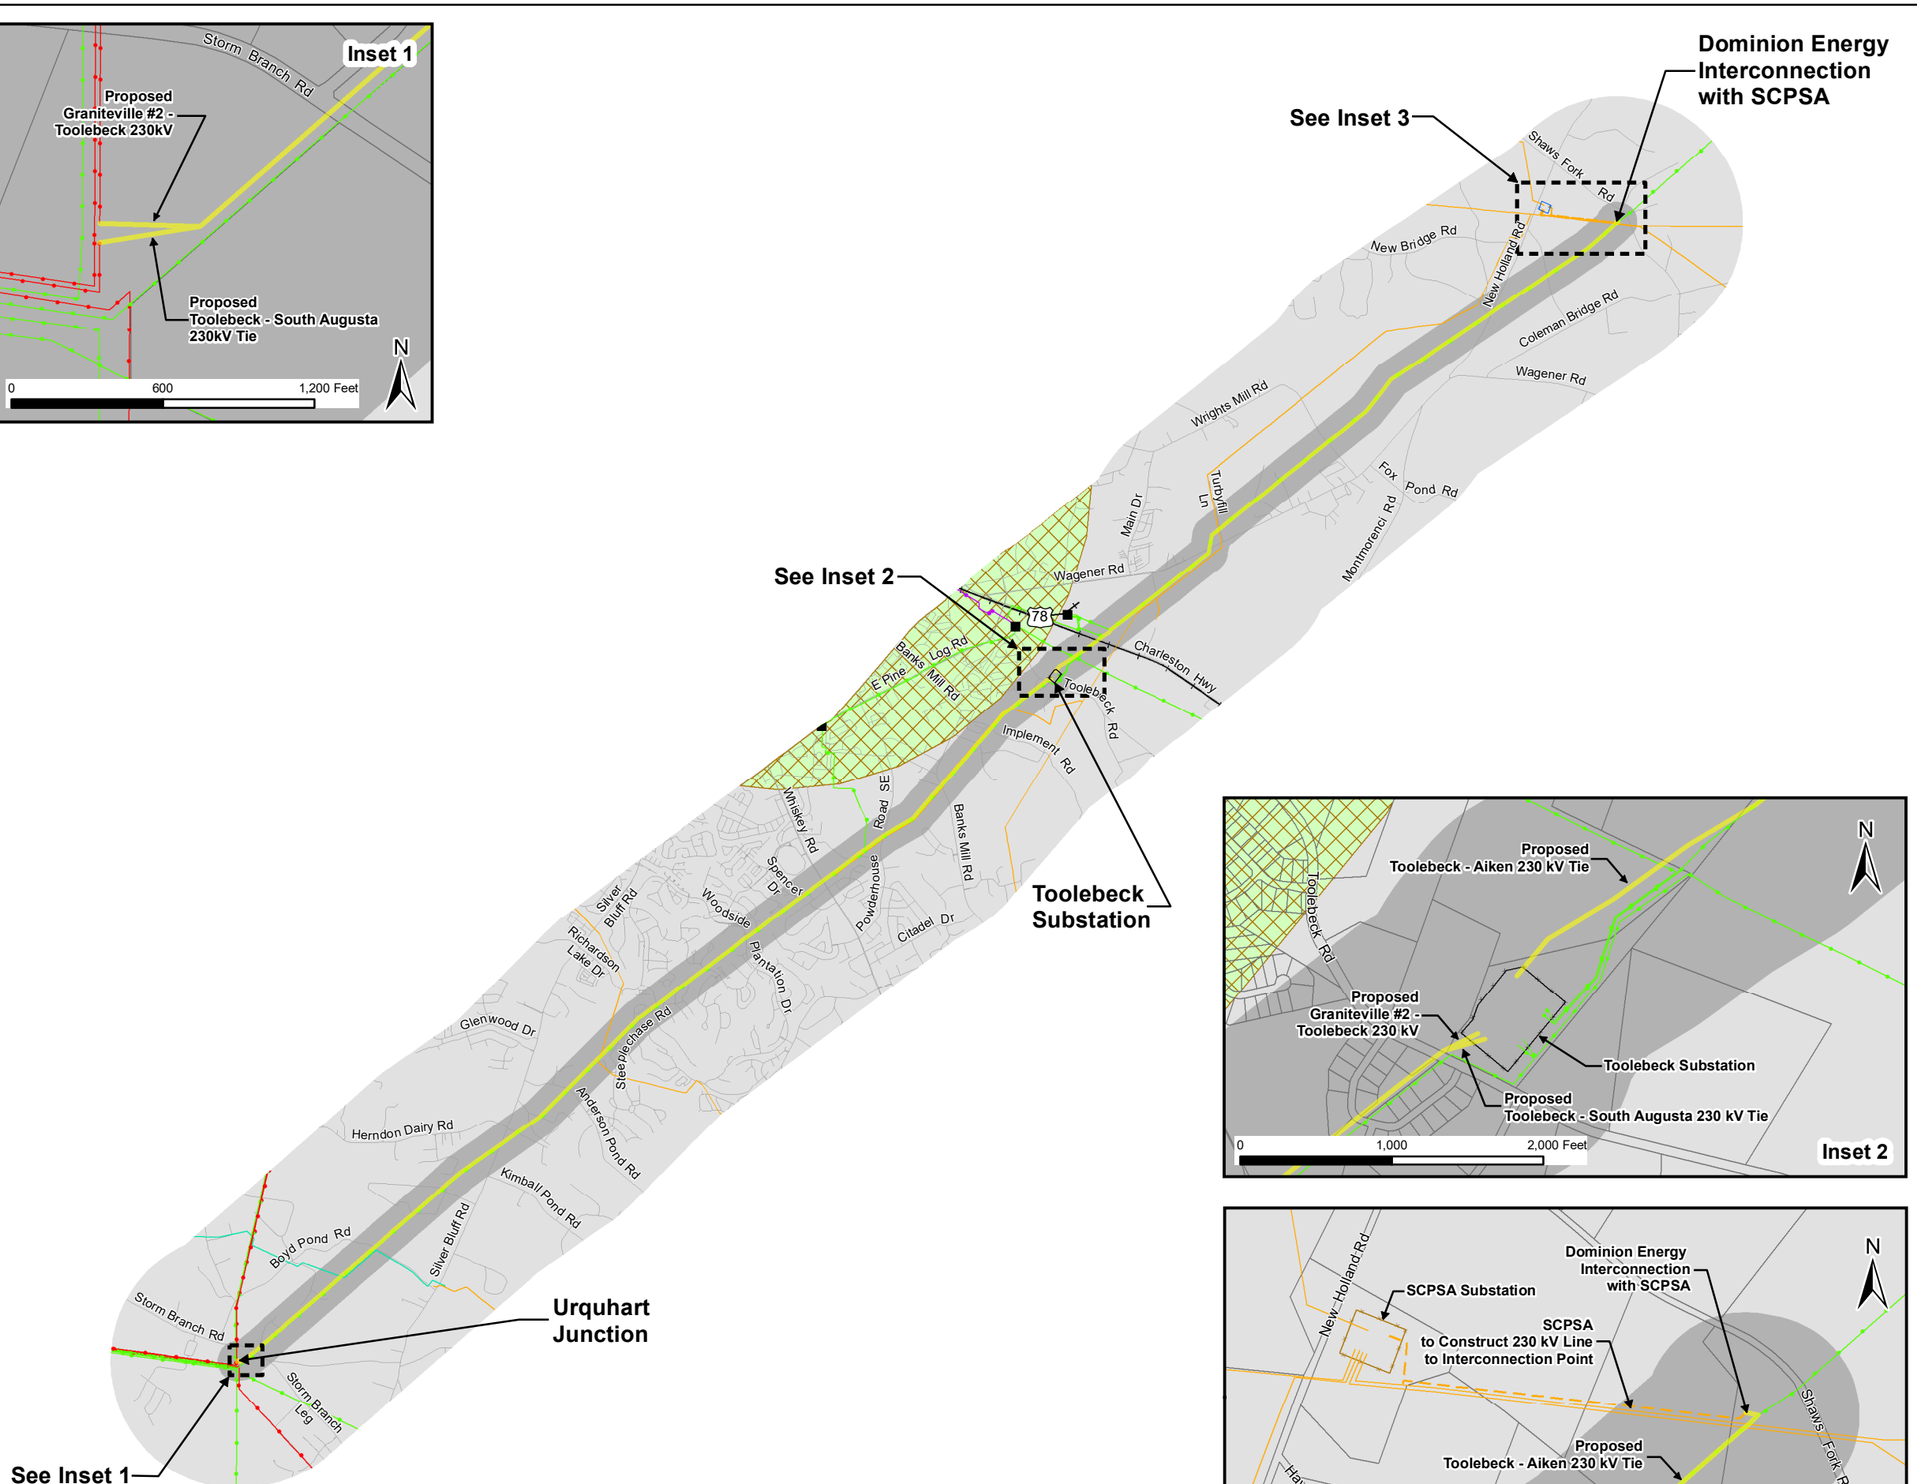

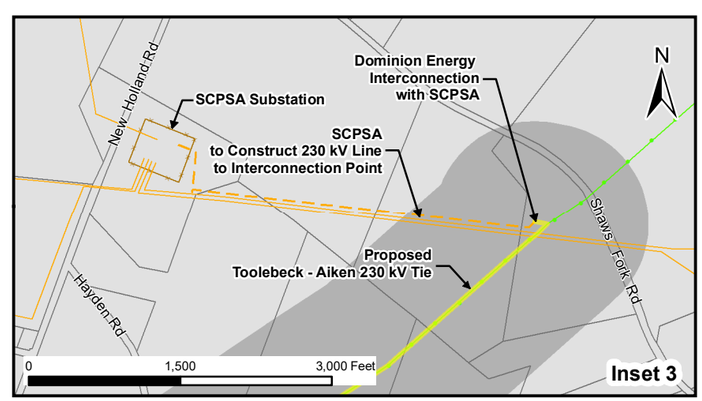

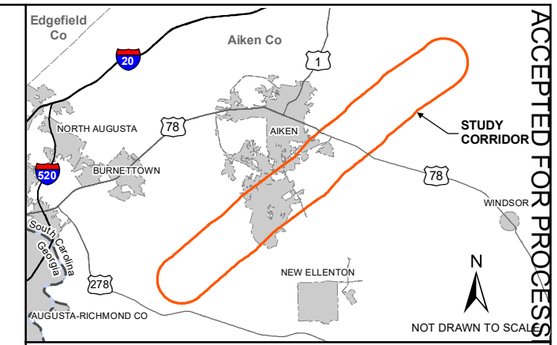

Legend

- Dominion Energy Substation
- Road
- Railroad
- Proposed Dominion Energy 230 kV Transmission Line
- Dominion Energy 46 kV Transmission Line
- Dominion Energy 115 kV Transmission Line
- Dominion Energy 230 kV Transmission Line
- SCPSA Transmission Line
- Central Electric Transmission Line
- Property Line
- Route Corridor
- Study Corridor
- Hoary Bat
- Winter Grape-fern

N W E S

0 1.5 3 Miles

Source: South Carolina Department of Natural Resources (Heritage Trust Program) and Palmetto Environmental Consulting, Inc.

Natural Resources

Toolebeck - Aiken 230 kV Tie, Graniteville #2 - Toolebeck 230 kV, Toolebeck - South Augusta 230 kV Tie, and Associated Facilities

Aiken County, SC

Dominion Energy

FIGURE 5.8